



P.O. Box 13231, 1700 N. Congress Ave.
Austin, TX 78711-3231, www.twdb.texas.gov
Phone (512) 463-7847, Fax (512) 475-2053

CATEGORICAL EXCLUSION

TO ALL INTERESTED AGENCIES AND PUBLIC GROUPS:

As provided by the environmental review process adopted in the rules of the Texas Water Development Board (TWDB), 31 Texas Administrative Code (TAC) § 371.41, for projects to be funded through the Drinking Water State Revolving Fund (DWSRF) program and consistent with the National Environmental Policy Act, 42 United States Code § 4321, *et seq.*, the TWDB has determined that the proposed action identified below may be exempted from comprehensive environmental review:

Westbound Water Supply Corporation, Eastland County, Texas
TWDB DWSRF Project No. 62942
Westbound WSC Water System Improvements
Program Logic Controller and System Control and Data Acquisition Improvements
Total Financing Amount: \$5,366,157.00 (L1001622, LF1001623)

The Westbound Water Supply Corporation (Corporation) is proposing to use \$5,366,157.00 in financing from the DWSRF program for the water system improvements, System Control and Data Acquisition (SCADA) improvements, project to replace a total of thirteen (13) existing, obsolete, and failing Programmable Logic Controllers (PLCs). All PLC upgrades take place within existing Remote Terminal Unit (RTU) enclosures or within the existing office building and will not require any excavation, construction or work activities outside of the RTU enclosures, or other perturbations of the natural environment. Additional work in the office building will include a new computer workstation, operating system, and SCADA software.

The locations of the PLC/SCADA improvements are listed below:

- 201 E 8th St., Cisco, Texas Office, Master Terminal Unit (MTU)
 - Replacement of failing PLCs within the existing office building
 - New computer workstation, operating system, and SCADA software
- Putnam Pump Station
 - Replacement of failing PLCs within existing RTU enclosures
- Dothan Control Valve
 - Replacement of failing PLCs within existing RTU enclosures
- College Pump Station
 - Replacement of failing PLCs within existing RTU enclosures
- South Pump Station
 - Replacement of failing PLCs within existing RTU enclosures

Our Mission

Leading the state's efforts
in ensuring a secure
water future for Texas

Board Members

L'Oreal Stepney, P.E., Chairwoman | W. Brady Franks, Board Member | Ashley Morgan, Board Member
Bryan McMath, Executive Administrator

Categorical Exclusion

Westbound Water Supply Corporation, Eastland County, Texas

TWDB DWSRF Project No. 62942

Westbound WSC Water System Improvements

Program Logic Controller and System Control and Data Acquisition Improvements

Page 2

- Eastland Pump Station
 - Replacement of failing PLCs within existing RTU enclosures
- Pleasant Hill Pump Station
 - Replacement of failing PLCs within existing RTU enclosures
- Two (2) Wells near Pleasant Hill Pump Station
 - Replacement of failing PLCs within existing RTU enclosures
- Standpipe Pump Station
 - Replacement of failing PLCs within existing RTU enclosures
- Pioneer Pump Station
 - Replacement of failing PLCs within existing RTU enclosures
- Five (5) Wells near the Pioneer Pump Station
 - Replacement of failing PLCs within existing RTU enclosures

This Categorical Exclusion is completed for the PLC/SCADA Improvement components, is hereafter referred to as the proposed project. Because the proposed components are numerous and spread throughout a large area, subsequent portions of the project will be completed under separate environmental findings.

The TWDB may not fund testing, remediation, removal, disposal, or related works for contaminated or potentially contaminated materials. However, the project proponent should ensure that, if found, such materials are tested, removed, and disposed of in accordance with applicable state and federal laws.

There are no previously recorded significant or potentially significant historical or cultural sites within or adjacent to the project footprint, according to the Texas Historical Commission's Archeological Sites Atlas, nor is the proposed project within a protected area surrounding a historic cemetery, structure, or district. The proposed project will not adversely impact waters of the United States, including wetlands. The proposed project is not located within a Special Flood Hazard Area; therefore, coordination with the local floodplain administrator was not required. In addition, the proposed project is not expected to impact threatened or endangered species or habitat.

The staff of the TWDB previously recommended issuance of a Categorical Exclusion (CE) for this project. The decision to grant this CE is allowed because the specified project elements will not cause significant adverse impacts to cultural and natural resources. Documentation supporting this determination is on file at the TWDB.

This determination shall be revoked if it is found that

- (1) the project no longer meets the requirements for categorical exclusion from full environmental review as a result of changes in the project;

- (2) the project involves extraordinary circumstances as described in 31 TAC §371.42;
or
- (3) the project may violate or has violated federal, state, local, or tribal laws.

The proposed project must comply with the following standard environmental conditions:

Standard Environmental Conditions

- Consistent with the TWDB Supplemental Construction Contract Conditions (TWDB-0550), the Westbound Water Supply Corporation (Corporation) will abide by the standard emergency condition for the discovery of cultural resources.
- Consistent with the TWDB Supplemental Construction Contract Conditions (TWDB-0550), the Corporation will abide by the standard emergency condition for the discovery of threatened and endangered species.


Comments regarding this determination may be submitted to the Director of Regional Water Project Development, Texas Water Development Board, P.O. Box 13231, Austin, Texas 78711-3231 or via email at RWPD-Environmental@twdb.texas.gov.

Sincerely,


Clay Schultz Digitally signed by Clay Schultz
Date: 2026.09.11 13:24:16 -05'00'

T. Clay Schultz, Ph.D., Director
Regional Water Project Development

Enclosures

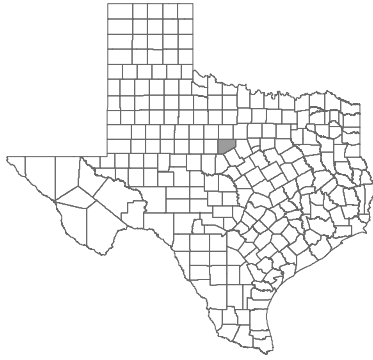

Westbound Water Supply Corporation Eastland County

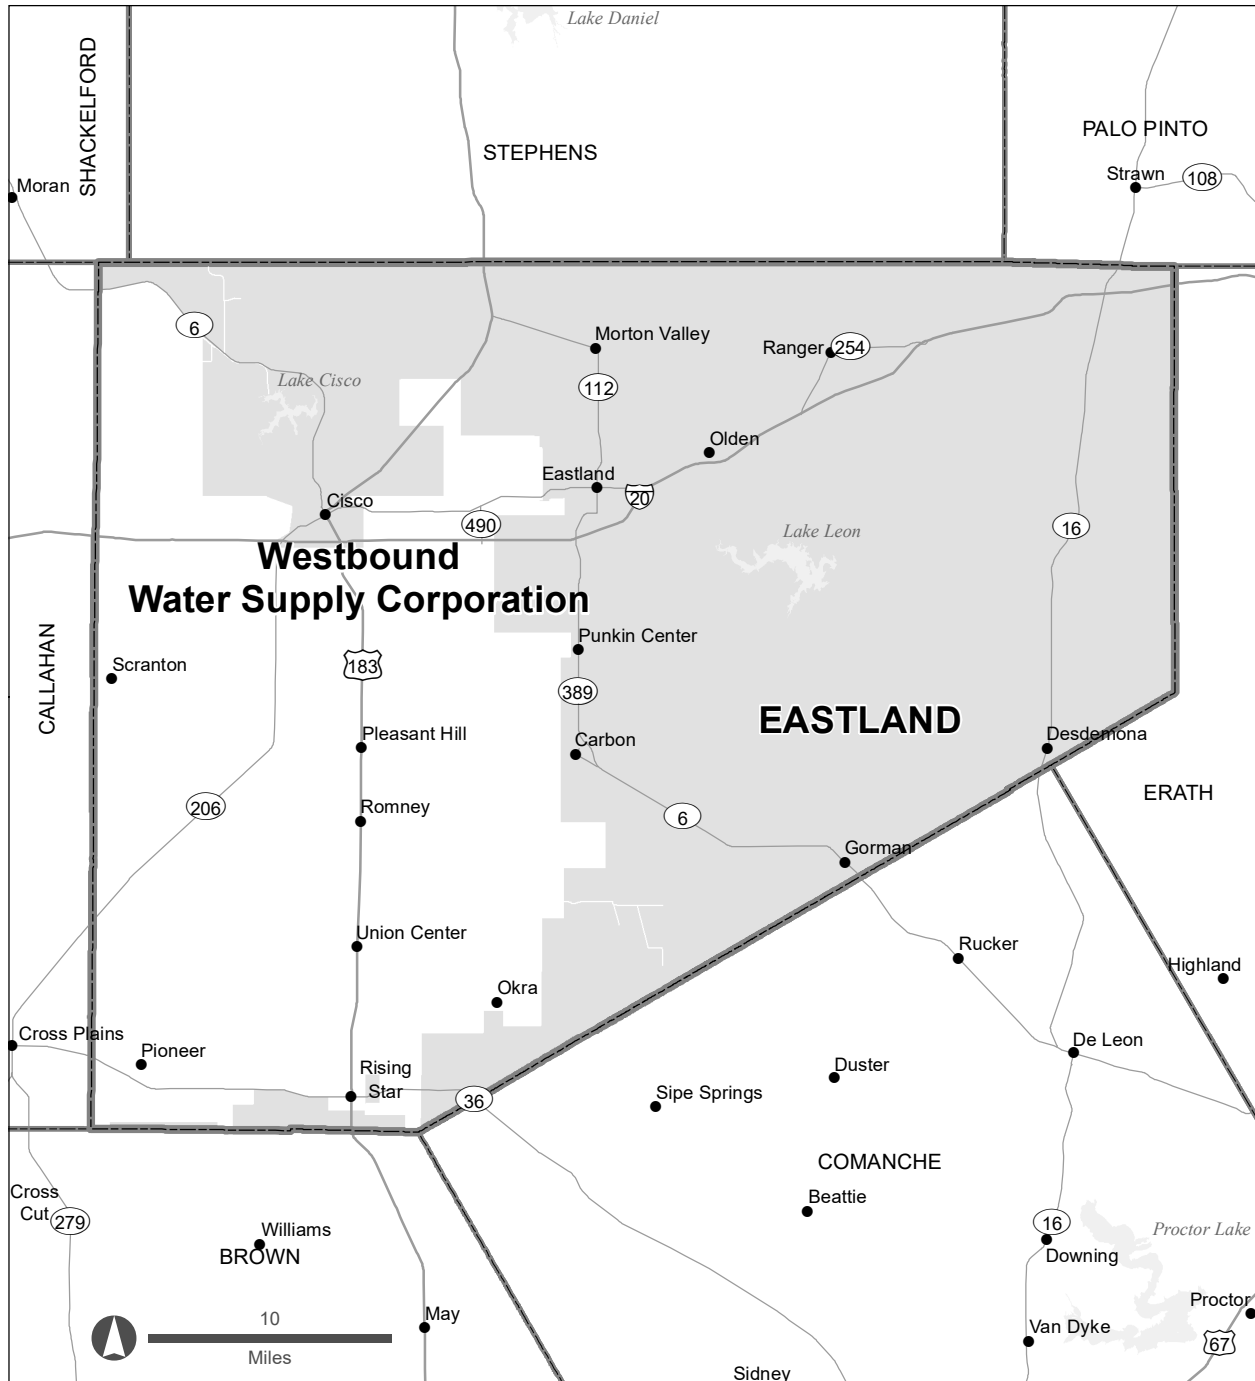

P:\Projects\Westbound WSC\8574 DWSRF Water System Imp\10 CAD\7 CONST\4 SHEETS\8574 - PLC SITE - ENLARGED AREAS.dwg



PUTNAM PUMP STATION

SCALE: 1" = 30'



DOTHAN VALVE LOCATION

SCALE: 1" = 30'

SHEET 2 OF 6



Enprotec | Hibbs & Todd

402 Cedar Street • Abilene, Texas 79601 • T: (325) 698-5550 • F: (325) 698-3240 • www.eht.com
PE Firm Registration No. 1151 • PG Firm Registration No. 50103 • RPLS Firm Registration No. 10011900

**WESTBOUND
WATER SUPPLY CORPORATION
EASTLAND COUNTY, TEXAS**

PLC SITE ENLARGED AREA MAP

8574
08/10/2026

P:\Projects\Westbound WSC\8574 DWSRF Water System Imp\10 CAD\7 CONST\4 SHEETS\8574 - PLC SITE - ENLARGED AREAS.dwg



COLLEGE PUMP STATION

SCALE: 1" = 50'



OFFICE MTU (MASTER PLC)

SCALE: 1" = 50'

SHEET 3 OF 6



Enprotec | Hibbs & Todd

402 Cedar Street • Abilene, Texas 79601 • T: (325) 698-5550 • F: (325) 698-3240 • www.eht.com
PE Firm Registration No. 1151 • PG Firm Registration No. 50103 • RPLS Firm Registration No. 1001900

**WESTBOUND
WATER SUPPLY CORPORATION
EASTLAND COUNTY, TEXAS**

PLC SITE ENLARGED AREA MAP

8574
08/10/2026

P:\Projects\Westbound_WSC\8574 DWSRF Water System Imp\10_CAD\7_CONST\4_SHEETS\8574 - PLC SITE - ENLARGED AREAS.dwg



EASTLAND PUMP STATION

SCALE: 1" = 50'



SOUTH PUMP STATION

SCALE: 1" = 50'

SHEET 4 OF 6



Enprotec | Hibbs & Todd

402 Cedar Street • Abilene, Texas 79601 • T: (325) 698-5550 • F: (325) 698-3240 • www.eht.com
PE Firm Registration No. 1151 • PG Firm Registration No. 50103 • RPLS Firm Registration No. 10011900

**WESTBOUND
WATER SUPPLY CORPORATION
EASTLAND COUNTY, TEXAS**

PLC SITE ENLARGED AREA MAP

8574
08/10/2026

P:\Projects\Westbound WSC\8574 DWSRF Water System Imp\10_CAD\7_CONST\4_SHEETS\8574 - PLC SITE - ENLARGED AREAS.dwg



PLEASANT HILL PUMP STATION

SCALE: 1" = 50'



SABANNO STANDPIPE

SCALE: 1" = 50'

SHEET 5 OF 6



Enprotec | Hibbs & Todd


402 Cedar Street • Abilene, Texas 79601 • T: (325) 698-5550 • F: (325) 698-3240 • www.eht.com
PE Firm Registration No. 1151 • PG Firm Registration No. 50103 • RPLS Firm Registration No. 10011900

**WESTBOUND
WATER SUPPLY CORPORATION
EASTLAND COUNTY, TEXAS**

PLC SITE ENLARGED AREA MAP

8574
08/10/2026

P:\Projects\Westbound_WSC\8574 DWSRF Water System Imp\10_CAD\7. CONST\4. SHEETS\8574 - PLC SITE - ENLARGED AREAS.dwg

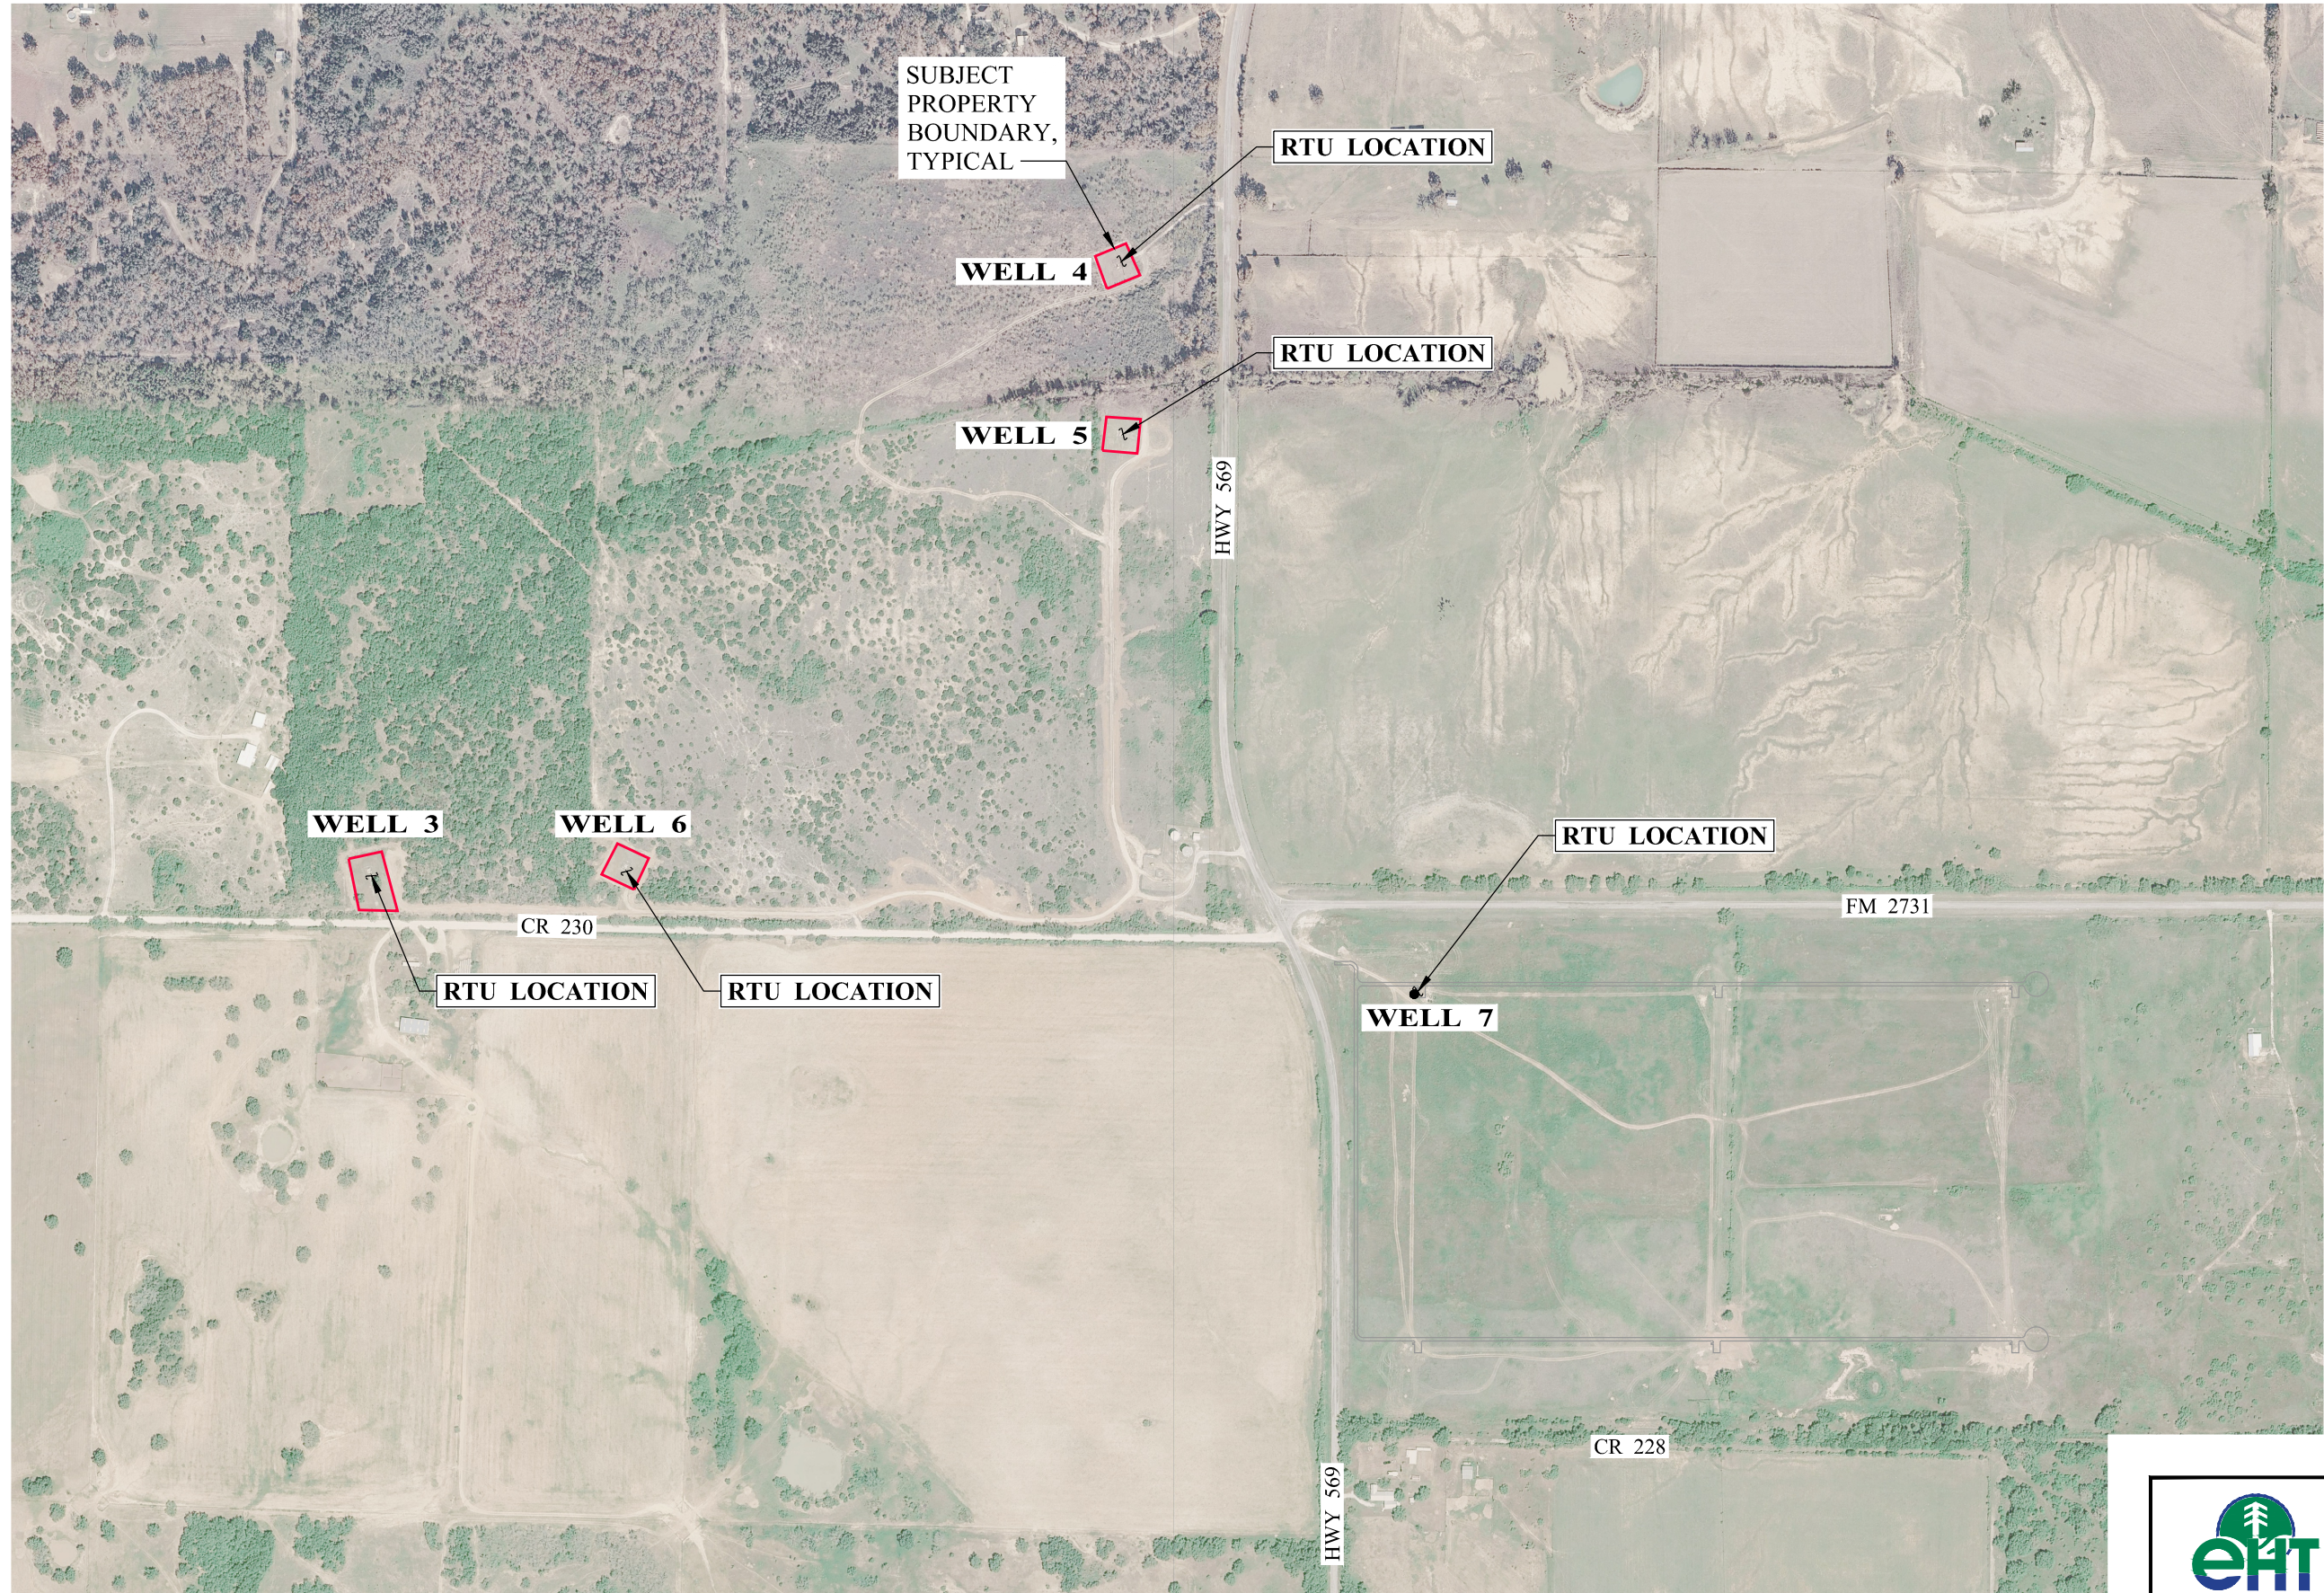

SHEET 6 OF 6



PIONEER WELL FIELD

SCALE: 1" = 500'



Enprotec | Hibbs & Todd

402 Cedar Street • Abilene, Texas 79601 • T: (325) 698-5500 • F: (325) 698-3240 • www.eht.com
PE Firm Registration No. 1151 • PG Firm Registration No. 50103 • RPLS Firm Registration No. 10011900

**WESTBOUND
WATER SUPPLY CORPORATION
EASTLAND COUNTY, TEXAS**

PLC SITE ENLARGED AREA MAP

8574
08/10/2026