Wells Sampled by the TWDB for Water Quality Analysis in 2008 (711 samples)

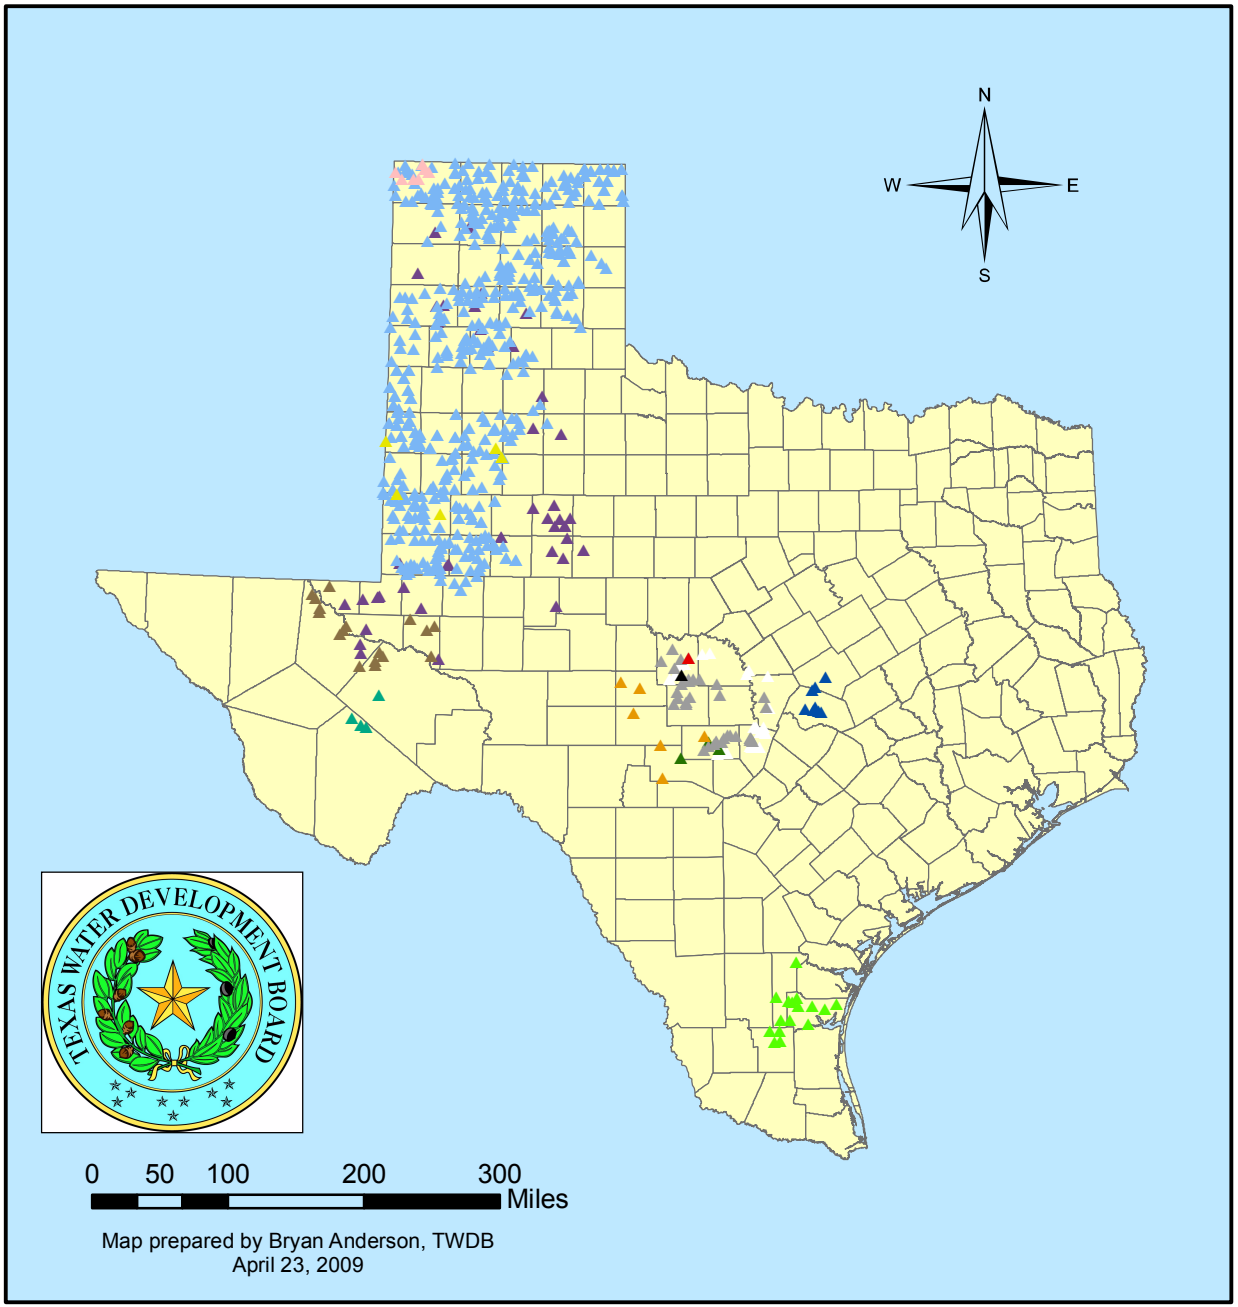

Aquifer (number of wells sampled)

- Capitan Reef (4)
- Dockum (45)
- Edwards BFZ (8)
- Edwards-Trinity High Plains (5)
- Edwards-Trinity Plateau (6)
- Ellenburger-San Saba (26)
- Gulf Coast (16)
- Hickory (36)
- Marble Falls (1)
- Ogallala (536)
- Other (1)
- Pecos Valley (17)
- Rita Blanca (7)
- Trinity (3)

Maximum Contaminant Levels (MCLs)

Of all samples collected by the TWDB in 2008, 10.5 percent exceeded the MCL for nitrate-nitrite, 16.4 percent for arsenic, 11.2 percent for flouride, 9.9 percent for lead, 2.9 percent for uranium, 2.6 percent for selenium, and 1.1 percent for gross alpha radiation.

See the 2008 summary for complete results.