


ACAD Rel 15.06s (LMS Tech) User: CAM
 [BRA02372]N:\WR\JM-REPORT\BRASTUDY\BRAZOS-STUDIES\BRAZOS\SCENARIO3.DWG LAYOUT: 11X17
 FEB 10, 2004 6:45:05 A.M. LTS: 6000.00 PSLTS: 0 TWIST: 0.0, 0.0, 0.0, 0.0
 REFERENCE FILE: D:\BRA-STUDIES\SCOTT.A\KERR-MC-MAP

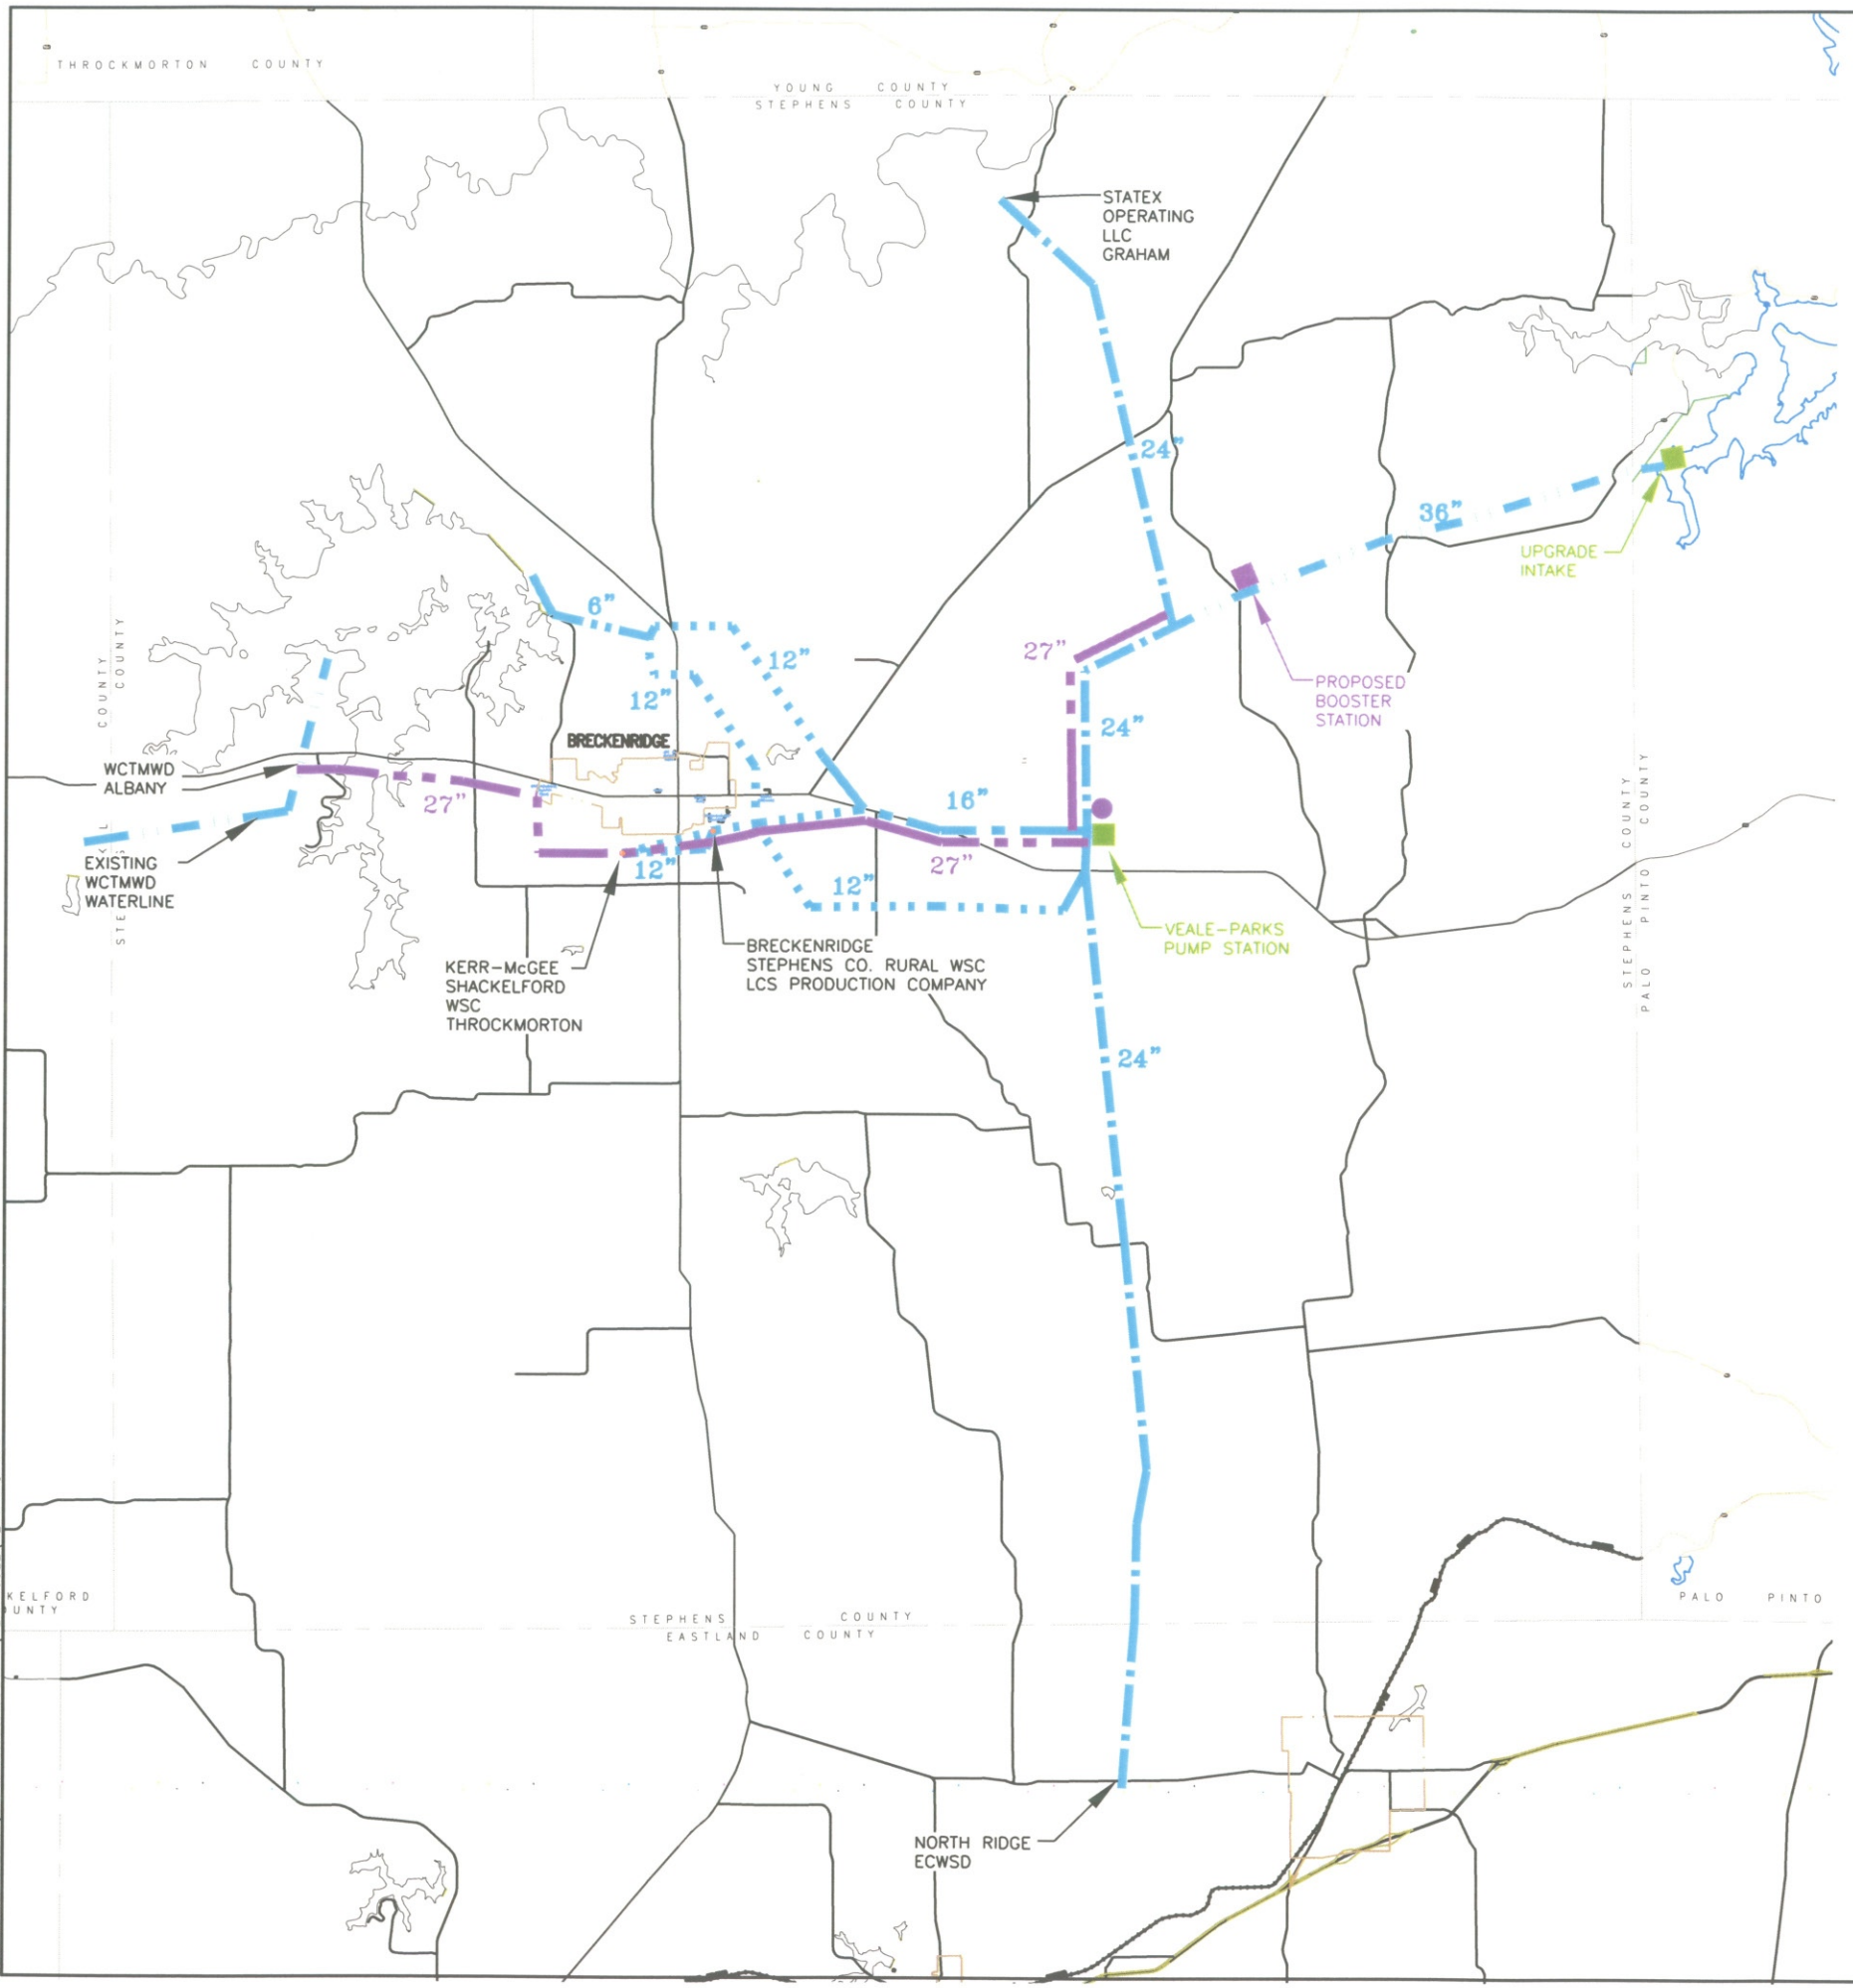

SCENARIO #2					
LONG TERM DEMANDS					
SEE TABLE 4.6 FOR DEMAND SCENARIOS					

PIPELINE IMPROVEMENTS					
TYPE OF UPGRADE	FROM	TO	LENGTH (MILES)		
NEW 27"	VEALE-PARK PS	W. BRECKENRIDGE	6.84		
NEW 27"	W. BRECKENRIDGE	WCTMWD	9.41		
NEW 27"	STATEX SPLIT	VEALE PARK PS	5.62		

PUMP STATION IMPROVEMENTS					
TYPE OF UPGRADE	LOCATION	PUMP FLOW (MGD)	TDH (FEET)		
EXISTING UPGRADE	INTAKE	32.24	577		
NEW	INTERMEDIATE BOOSTER	58.04	350		
EXISTING UPGRADE	VEALE-PARKS	51.47	465		

TANK IMPROVEMENTS					
TYPE OF UPGRADE	LOCATION	TYPE OF TANK	SIZE (MG)	HEIGHT (FEET)	WATER LEVEL (FEET)
NEW	VEALE-PARKS	GST	5.0	40	39

LEGEND

EXISTING

WATER LINE:

PUMP STATION:

STORAGE TANK:

CURRENTLY PROPOSED

WATER LINE:

PUMP STATION:

STORAGE TANK:

BRA UPGRADE PROPOSAL

14" WATER LINE:

PUMP STATION:

STORAGE TANK:

BRA NEW PROPOSALS

WATER LINE:

PUMP STATION:

STORAGE TANK:

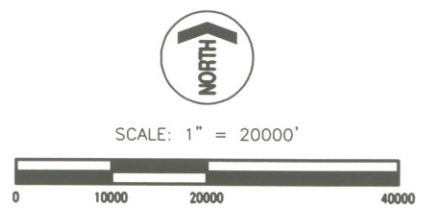


FIGURE F.11
WEST CENTRAL BRAZOS
WATER DISTRIBUTION SYSTEM
WEST CENTRAL BRAZOS STUDY
SCENARIO #2